

1
2
3
4

FDA



2017 1

2017 1 11

[2017] 2

2020 6

10: 00

6: 00

20000

FDA

88

83

FDA

2822m²

4452m²

1

1

| | | | | |
|--|---|-------|-------|--|
| | | | | |
| | / | 10000 | 10000 | |
| | / | 10000 | 10000 | |
| | / | 10000 | 10000 | |

2

1

2

| | | | | |
|--|--|------|---------|--|
| | | | | |
| | | | 100.365 | |
| | | 10 L | 10000 | |
| | | | 10000 | |
| | | | 10000 | |

| | | | | |
|--|--|--|-------|--|
| | | | 10000 | |
| | | | 10000 | |
| | | | 10000 | |
| | | | 18 | |

2

3

| | | | | |
|--|--|-------|--------|--|
| | | | | |
| | | | 100.29 | |
| | | | 25.075 | |
| | | 10 L | 10000 | |
| | | | 10000 | |
| | | | 10000 | |
| | | | 10000 | |
| | | 10000 | | |
| | | | 10000 | |
| | | | 18 | |

3

4

| | | | | |
|--|--|------|--------|--|
| | | | | |
| | | | 100.37 | |
| | | | 12.67 | |
| | | 10 L | 10000 | |
| | | | 10000 | |
| | | | 10000 | |
| | | | 10000 | |
| | | | 10000 | |
| | | | 10000 | |
| | | | 18 | |

3


5

1.

| | | | | | |
|-----|-----|-----------|---|---|--|
| 5. | | / | 2 | 2 | |
| 6. | | / | 4 | 4 | |
| 7. | | HBD-200 | 4 | 4 | |
| 8. | | / | 2 | 2 | |
| 9. | | / | 2 | 2 | |
| 10. | | / | 2 | 2 | |
| 11. | | / | 2 | 2 | |
| 12. | | / | 2 | 2 | |
| 13. | | / | 2 | 2 | |
| 14. | | / | 2 | 2 | |
| 15. | | / | 2 | 2 | |
| 16. | | / | 2 | 1 | |
| 17. | | / | 2 | 1 | |
| 18. | | №30-7.5 | 1 | 1 | |
| 19. | | 10 / | 1 | 1 | |
| 20. | | 5 3/ | 1 | 1 | |
| 21. | | 1 / | 1 | 1 | |
| 22. | | 1000L | 2 | 2 | |
| 23. | | 1000L | 2 | 2 | |
| 24. | | 1000L | 2 | 2 | |
| 25. | | 80 / | 2 | 2 | |
| 26. | | K G-700 | 2 | 2 | |
| 27. | | -700 | 2 | 2 | |
| 28. | | KJQ -26E | 2 | 2 | |
| 29. | | MQ 1.2 | 2 | 2 | |
| 30. | | DMH | 2 | 2 | |
| 31. | | 4000L | 2 | 2 | |
| 32. | | CHI4-40 | 1 | 1 | |
| 33. | | GA30C-7.5 | 1 | 1 | |
| 34. | | 0.8 3 | 1 | 1 | |
| 35. | CIP | / | 1 | 1 | |
| 36. | | KJ -16A | 2 | 0 | |
| 37. | | K F-500 | 0 | 2 | |

4

4.1

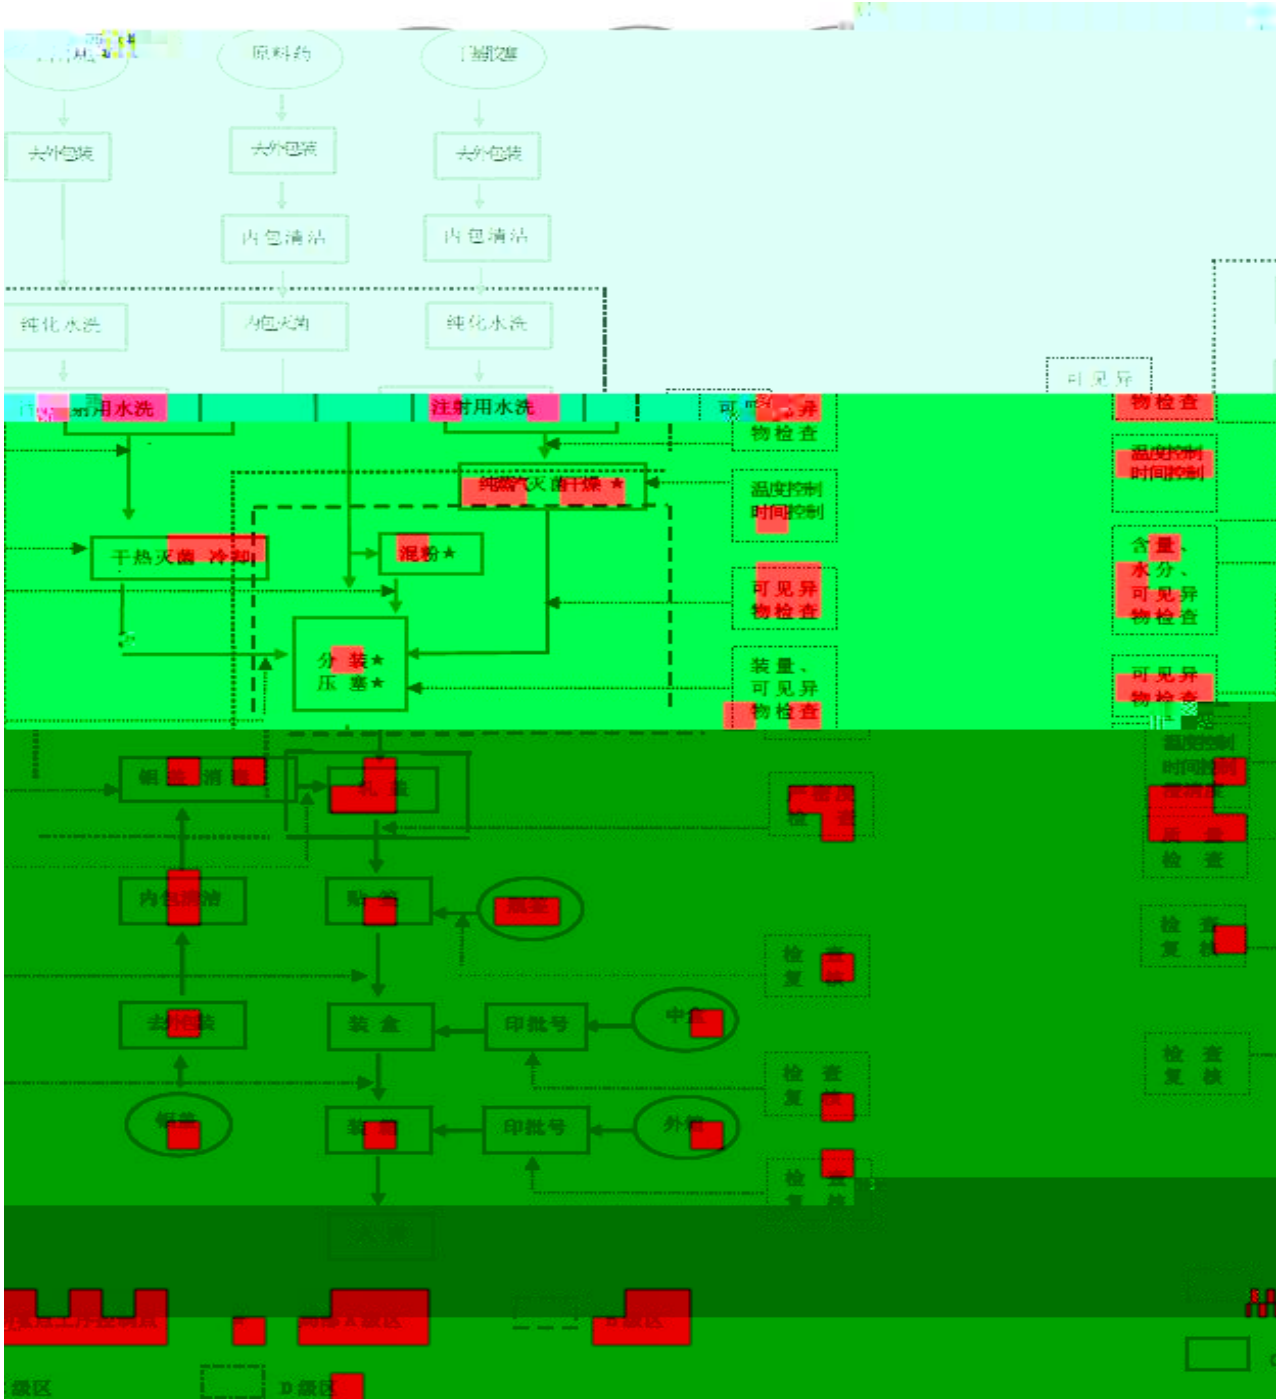

4. 2

6

| | | | | | | |
|--|-----|-----------------------|--------------------|-----|-----------------------|-------------------|
| | | | | | | |
| | FDA | 48 | 48 | FDA | 34 | 83 |
| | | | 2304m ² | | FDA | |
| | | | | | 2822m ² | |
| | | | | | | |
| | | 1920 m ² | | | 4345 m ² | |
| | | | | | | |
| | | 35KV | 35KV | | 35KV | 35KV |
| | | | 22000KVA | | | 22000KVA |
| | | | | | | |
| | | 500m ³ | | | 500m ³ | |
| | | 4000m ³ /d | | | 4000m ³ /d | |
| | | | A2/O | | | A ² /O |

| | | | | |
|--|--|--------|--|--------|
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | 1500m³ | | 1500m³ |

1 2023 3 18

2 2023 3 21 2023 4 20

3 2023 3 23 2023 6 23

/

1

2

1

2

1420t /a

3

+ + A2/O+ +

4000m³ /d


3250m³ /d

750m

³ /d

122m³ /d

3%

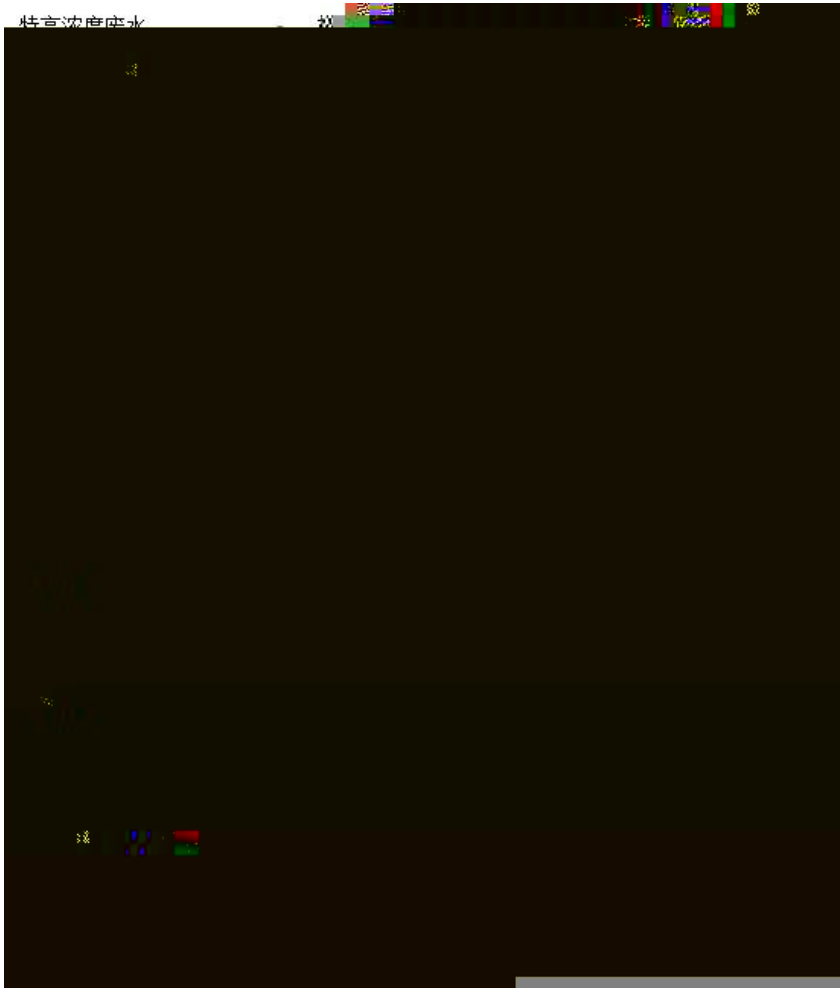

2

3

GB12348-2008 2

4

27.75t/a

5t/a

0.25t/a

HW02 272-005-022

1. 61t/a
272-005-022

1. 36t/a

0. 25t/a

HW02

5

PH

COD

1

1

2023 3 20